



# BYBU.XR704 - FIRE-RESISTANCE RATINGS - ANSI/UL 1709

## Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

---

## BYBU - Fire-resistance Ratings - ANSI/UL 1709


See General Information for Fire-resistance Ratings - ANSI/UL 1709


### Design No. XR704

January 03, 2020

**Ratings — 3/4, 1, 1-1/2, 2, 2-1/2, 3 or 4 Hr**

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

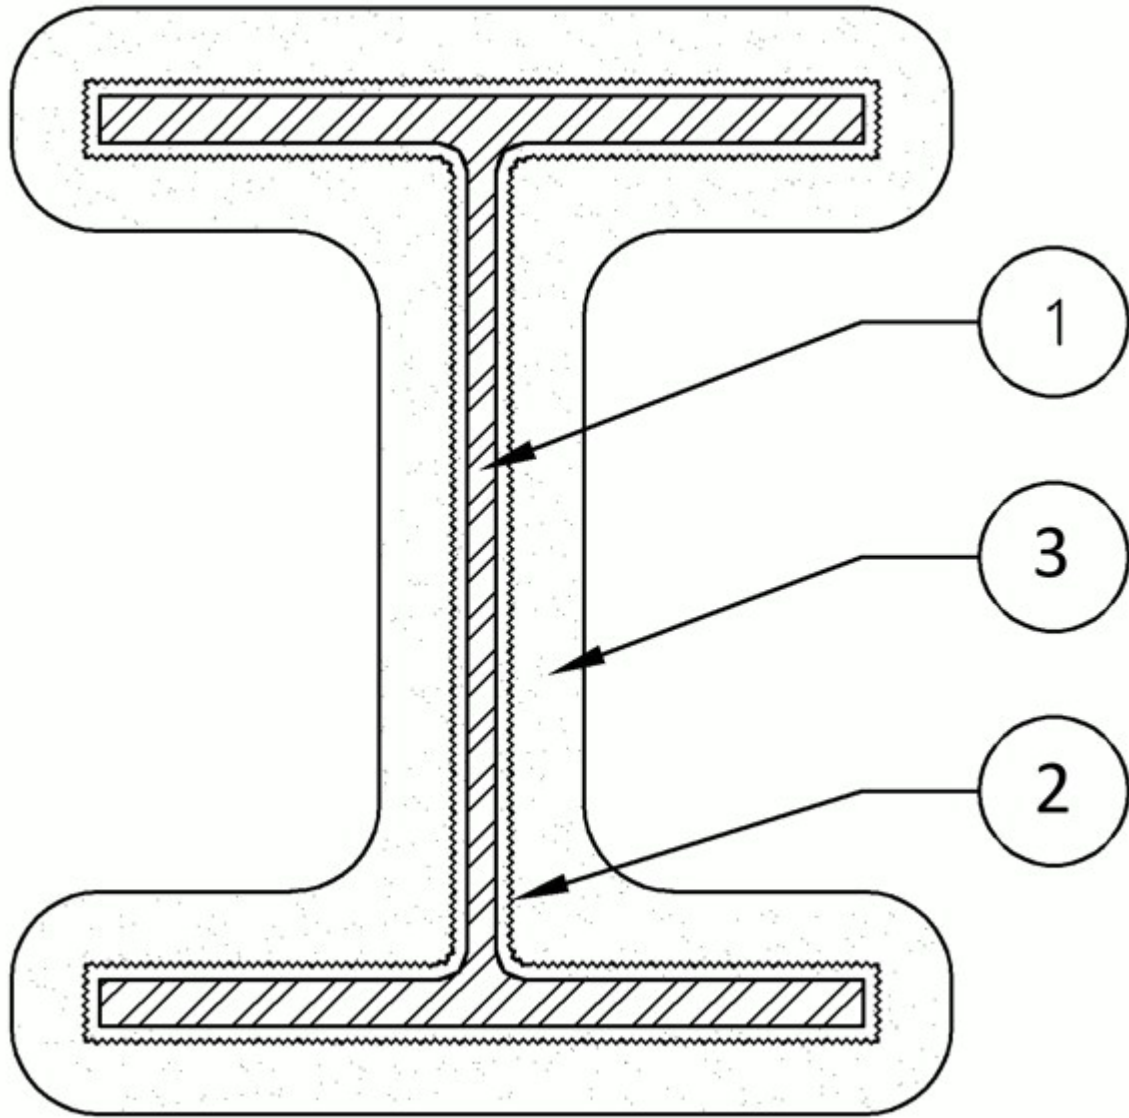

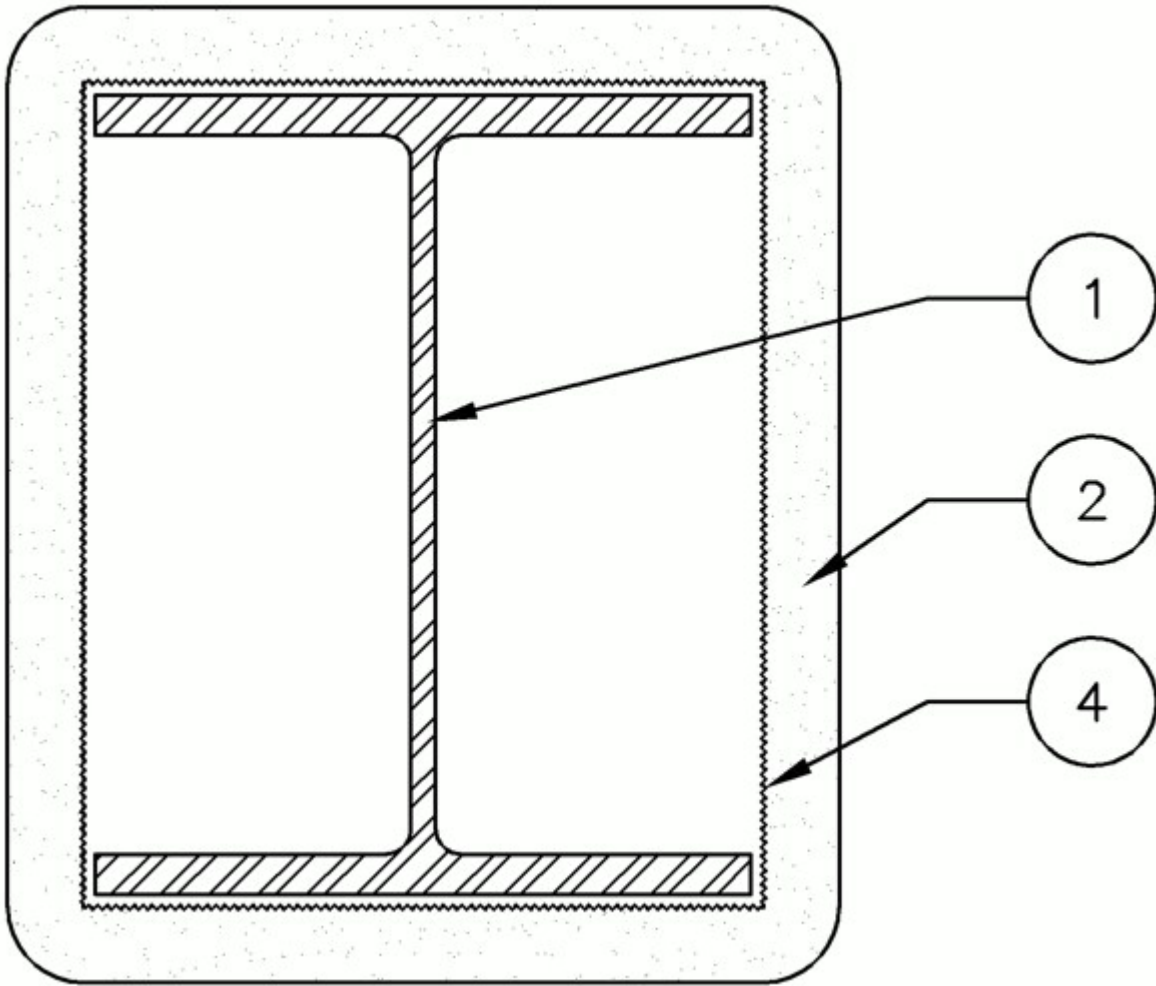

1. **Steel Column** — Min size of column W10x49.

2. **Spray-Applied Fire Resistive Materials\*** — See table below for appropriate thickness. Prepared by mixing with water according to instructions on each bag of mixture and spraying in one or more coats, as necessary, directly to the column or onto the metal lath surfaces, which must be clean and free of dirt, loose scale and oil. As an alternate to spraying, Type M-II/P may be machine mixed and trowel applied. Min avg density of 44 pcf, with min ind. value of 40 pcf for Type M-II. Min avg density of 47 pcf, with min ind. value of 43 pcf for Type M-II/P. Min avg density of 44 pcf, with min ind value of 42 pcf for Type TG. For method of density determination, see Design Information Section, Sprayed Material. Types M-II, M-II/P, and TG investigated for UL 2431 Classification Category I-A and Exterior Environmental Purpose.

Rating, Hr	Min Thickness, In.(mm) Contour Application	Min Thickness, In. (mm) Boxed Protection
3/4	11/16 (17.5)	11/16 (17.5)
1	13/16 (20.7)	13/16 (20.7)
1-1/2	1-1/16 (27.0)	15/16 (23.9)
2	1-5/16 (33.4)	15/16 (23.9)
2-1/2	1-9/16 (39.7)	1-3/16 (30.2)
3	1-13/16 (46.0)	1-7/16 (36.6)
4	2-5/16 (58.8)	2-1/4 (57.2)

**BERLIN CO LTD** — Type M-II or Type TG, investigated for exterior use, and additionally evaluated for acid and solvent spray exposure.

**GREENTECH ASIA PACIFIC SDN BDH** — Types M-II or M-II/P, investigated for exterior use, and additionally evaluated for acid and solvent spray.

**GREENTECH THERMAL INSULATION PRODUCTS MFG CO L L C** — Type M-II, M-II/P or TG. Type M-II, M-II/P or TG investigated for exterior use, and additionally evaluated for acid and solvent spray exposure.

**ISOLATEK INTERNATIONAL** — Type M-II, M-II/P or Type TG investigated for exterior use, and additionally evaluated for acid and solvent spray exposure.

**NEWKEM PRODUCTS CORP** — Type M-II, M-II/P or Type TG, investigated for exterior use, and additionally evaluated for acid and solvent spray exposure.

**PERLITE ITALIANA SRL** — Type M-II or M-II/P, investigated for exterior use, and additionally evaluated for acid and solvent spray exposure.

The thicknesses of Spray-Applied Fire Resistive Materials shown below are applicable when the protection of the column flange edges is reduced to one-half.

**Min Required Thickness (inch) for Hourly Rating Period (min)**

Column Size	45	60	90	120	150	180	240
W10x49	3/4	7/8	1-3/16	1-1/2	1-13/16	2-1/8	2-11/16

**Min Required Thickness (mm) for Hourly Rating Period (min)**

Column Size	45	60	90	120	150	180	240
W10x49	19.1	22.3	30.2	38.1	46.1	54	68.3

3. **Reinforced Mesh** — Galv steel wire, No. 20 SWG, twisted to form 1 or 2 in. hexagons. Embedded in Spray-Applied Fire Resistive Materials approximately mid-depth of coating. Wrapped around the entire column surface, with minimum 1 inch overlap. Attached with pins and washer to center of webs and flanges, spaced 16 in OC.

3A. **Metal Lath (Not Shown)** — In lieu of the reinforced mesh, galv. expanded steel lath, weighing 3.4 lb per sq yd may be used. Lath wrapped around entire column surface with minimum 1 in overlap. Secured with power actuated fasteners located at the center of webs and flanges, spaced 18 in OC.

4. **Metal Lath** — For boxed type protection. Min 3.4 lb per sq yd expanded steel. Lath lapped minimum 1 in. at vertical joint on column flange and secured with power actuated fasteners, located at the center of the flanges, spaced 18 in OC.

4A. **Corner Bead** — (Optional - Not Shown) — No. 25 MSG galv expanded steel corner bead with minimum 2-in legs. May be used in conjunction with column cage. When used, placed over each corner of column cage and attached to metal lath with tie wire spaced 18 in. O.C.

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2020-01-03

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2020 UL LLC"