

## BXUV.P723

## Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

## BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

## BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

[See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances](#)

[See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances](#)

### Design No. P723

**Restrained Assembly Ratings — 1, 1-1/2, 2 and 3 Hr**  
(See Items 3 and 8)






**Unrestrained Assembly Ratings — 1, 1-1/2, 2 and 3 Hr**  
(See Items 3 and 8)


**Unrestrained Beam Ratings — 1, 1-1/2, 2 and 3 Hr.**  
(See Items 3 and 8)

**Restricted Load Condition — See Item 8**

**This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide [BXUV](#) or [BXUV7](#)**

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

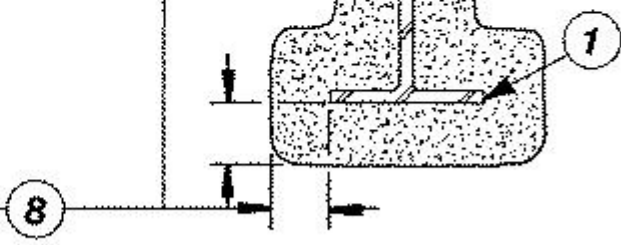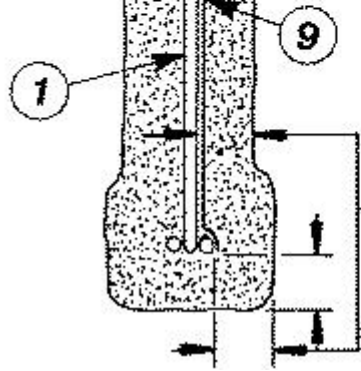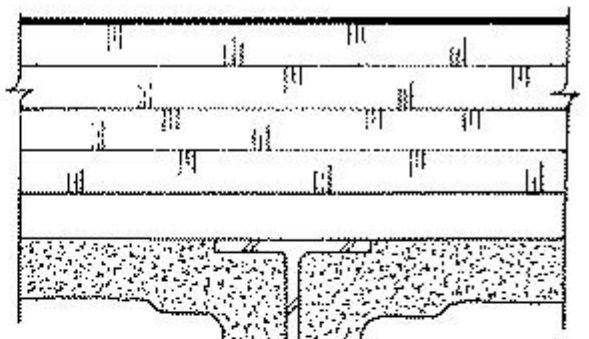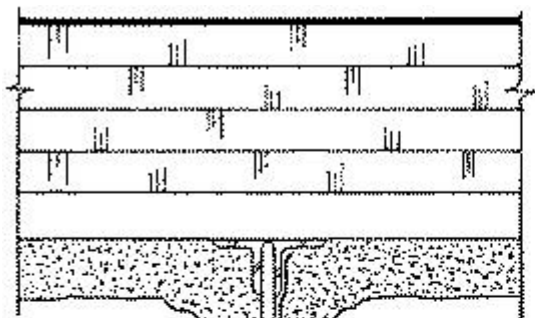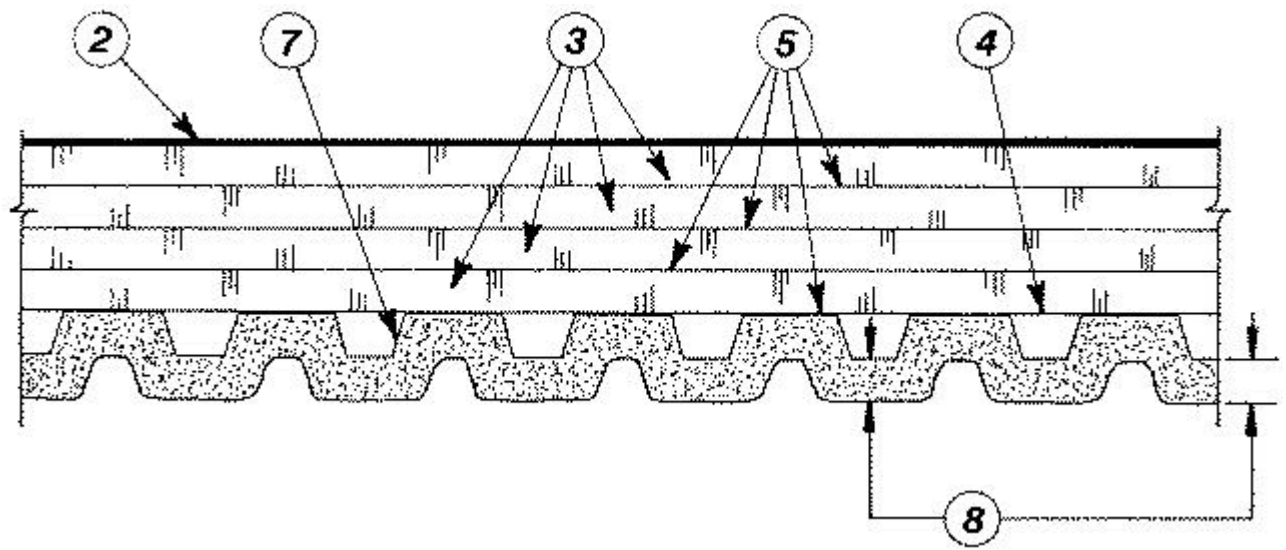

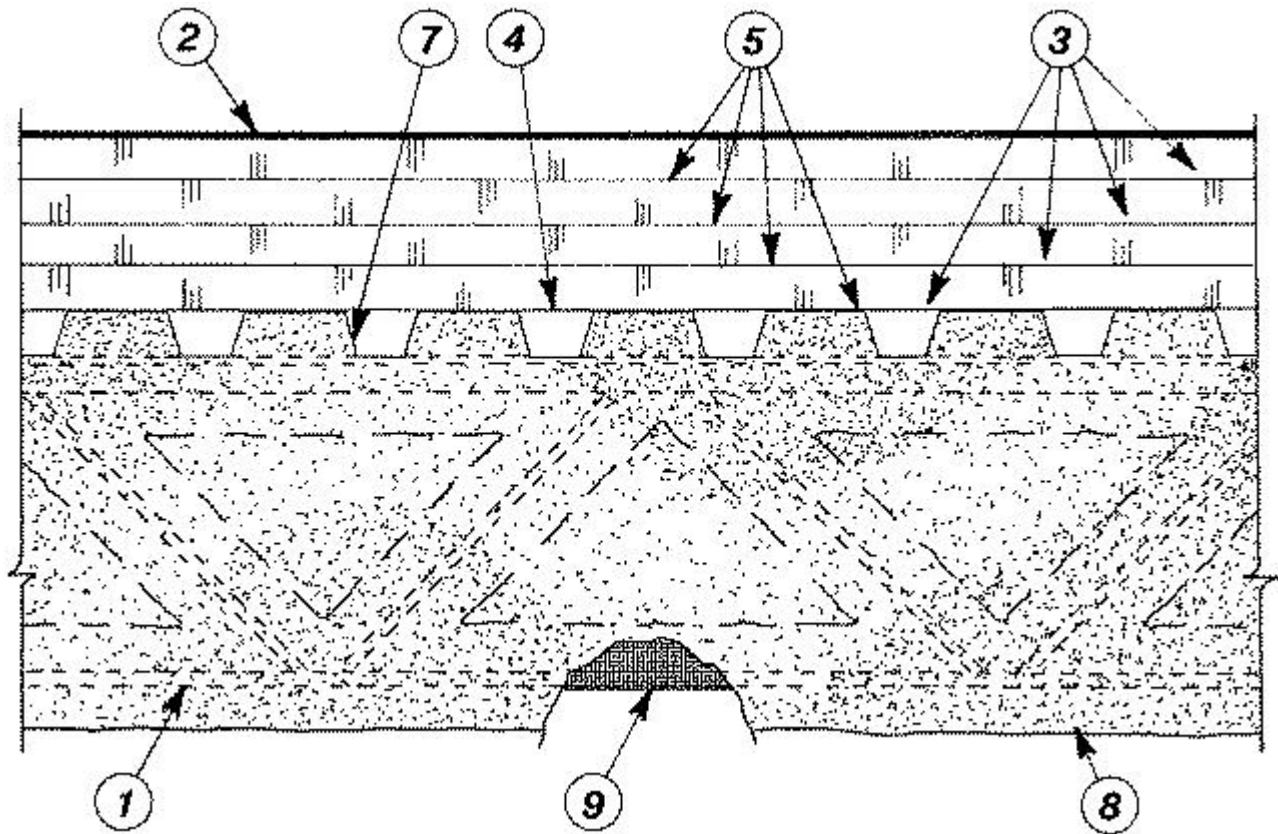

1. **Steel Supports** — W6x16 steel beam, 10K1 or 12K5 steel joists min size (See Item 8).

2. **Roof Covering** — Consisting of hot mopped or cold application bituminous materials compatible with the insulation(s) described herein which provide Class A, B or C coverings. See Roofing Materials and Systems Directory-Roof Covering Materials (TEVT).

2A. **In lieu of Item 2, roof covering consisting of single-ply Roofing Membranes\*** — that is either ballasted, adhered or mechanically attached as permitted under the respective manufacturer's Classification. See Roofing Membranes (CHCI) category for names of manufacturers.

2B. **Metal Roof Deck Panels** — (Not Shown) — In addition to or in lieu of items 2 or 2A, the Roof Covering may consist of mechanically fastened metal roof deck panel assembly. See Fire Resistance Directory — Metal Roof Deck Panels (CETW).

3. **Roof Insulation — Foamed Plastics\*** — 36 by 48 in. (min size) polyisocyanurate foamed plastic insulation boards applied in one or more layers. Min thickness is 2.0 in. (No limit on max overall thickness.) Boards to be installed with end joints staggered a min of 6 in. in adjacent rows. When applied in more than one layer, each layer to be offset in both directions from layer below a min of 6 in. in order to lap all joints. Polyisocyanurate foamed plastic insulation may be installed over a max 1 in. thick layer of Mineral and Fiber Boards\* (Item 3B) with each layer offset in both directions as described above.

**ATLAS ROOFING CORP** — ACFoam II, Tapered ACFoam II, ACFoam II NH, Tapered ACFoam II NH, ACFoam III, ACFoam III NH, Tapered ACFoam III NH, ACFoam IV, ACFoam Supreme, ACFoam Supreme NH, AC Foam Recover Board, ACFoam Recover Board NH

**MULE-HIDE PRODUCTS CO INC** — POLY ISO 2

**CARLISLE SYNTEC SYSTEMS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — Types HP, HP-H, HP-N, HP-W, SecurShield CD, InsulBase NH, SecurShield NH, SecurShield HD Composite NH, Polyiso HP-F NH, InsulBase RL, SecurShield RL, Polyiso HP-F.

**DOW ROOFING SYSTEMS L L C** — "Dow Termico Polyisocyanurate Insulation", "Dow Termico ISO 3000 Insulation", "Dow Termico ISO HP-FR".

**FIRESTONE BUILDING PRODUCTS CO L L C** — "ISO 95+ GL", "ISO 95+ FK", "ISO 95+ CAN", "ISO 95+ GL NH", "ISOGARD HD Composite Board", "RESISTA", "ISOGARD GL", "ISOGARD CG".

**GAF** — EnergyGuard™ RA

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H Shield, H-Shield-F, H-Shield-CG, H-Shield-C, H-Shield Premier, H-Shield HD Composite, H-Shield HD Composite CG, H-Shield RL, H-Shield CG RL, H Shield NH, H-Shield-F NH, H-Shield-CG NH, H-Shield-C NH, H-Shield Premier NH, H-Shield HD Composite CG NH.

**MULE-HIDE PRODUCTS CO INC** — Poly ISO 1, Tapered Poly ISO 1, Poly ISO 1-DWD, Tapered Poly ISO 1-DWD, Poly ISO 1-HD, Poly ISO 1-HD90, Poly ISO 1-HD-Composite

**JOHNS MANVILLE** — ENRGY 3 25 psi, ENRGY 3, Tapered ENRGY 3, Tapered ENRGY 3 25 psi, ENRGY 3 AGF, Tapered ENRGY 3 AGF, ENRGY 3 25 psi AGF, Tapered ENRGY 3 25 psi AGF, ENRGY 3 CGF, Tapered ENRGY 3 CGF, ENRGY 3 25 psi CGF, Tapered ENRGY 3 25 psi CGF, ISO-3, Tapered ISO-3, ValuTherm, Tapered ValuTherm, ValuTherm 25 psi, Tapered ValuTherm 25 psi, ValuTherm AGF, Tapered ValuTherm AGF, ValuTherm 25 psi AGF, Tapered ValuTherm 25 psi AGF, ValuTherm CGF, Tapered ValuTherm CGF, ValuTherm 25 psi CGF, Tapered ValuTherm 25 psi CGF.

**LOADMASTER SYSTEMS INC** — Loadmaster Polyisocyanurate Insulation.

**MARTIN FIREPROOFING CORP** — "Perform-A-Deck I"

**RMAX, A BUSINESS UNIT OF SIKA CORPORATION** — Multi-Max-3, Multi-Max FA-3, Ultra-Max, Ultra-Max Plus, Tapered Ultra-Max Plus, Tapered Thermarroof-3, Tapered Thermarroof FA-3, Tapered Ultra-Max.

**SIKA SARNAFIL INC** — Sarnatherm-R Insulation, Sarnatherm-R CG Insulation, Sarnatherm-R Tapered Insulation, Sarnatherm-R CG Tapered Insulation.

**SOPREMA INC** — Sopra-ISO s, Sopra-ISO s Tapered, Sopra-ISO+ s, Sopra-ISO+ s Tapered, Sopra-ISO H+ s, Sopra-ISO H+ s Tapered.

**VERSICO INC** — SecurShield HD Composite, WeatherBond XFP HD Composite, VersiCore MP-H NH, WeatherBond XP NH, SecurShield NH, WeatherBond XFP NH, VersiCore RL, SecurShield RL, Polyiso MP-HF NH

**3A. Roof Insulation — Mineral and Fiber Boards\*** — (Not Shown) For 1, 1-1/2 and 2 h Ratings— As an alternate to Item 3. To be applied in one or more layers with or without adhesive applied between vapor barrier and roof deck units, vapor barrier and board and each layer of board. When more than one layer is required, each layer of board to be offset in both directions from layer below a min of 6 in. in order to lap all joints. Min thickness is 2 in. when Item 2A is used. When installed as a base layer for Item 3 (polyisocyanurate roof insulation) max thickness is 1 in.

**GAF** — GAFTEMP Perlite.

#### **JOHNS MANVILLE**

**3B. Building Units\*** — (Not Shown) — As an alternate to Items 3 and 3A. Polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in., faced on the top surface with oriented strand board or plywood. For the building units, min thickness (as measured at core) of the polyisocyanurate foamed plastic insulation is 2.0 in. (No limit on max thickness). Building units to be installed with end joints staggered a min 6 in. in adjacent rows.

**ATLAS ROOFING CORP** — ACFoam Nail Base Insulation, ACFoam Nail Base Insulation NH, Vented-R, ACFoam CrossVent, ACFoam CrossVent NH, ACFoam III Nail Base Insulation, ACFoam III Nail Base Insulation NH, ACFoam III CrossVent, ACFoam III CrossVent NH

**FIRESTONE BUILDING PRODUCTS CO L L C** — Hailgard, "ISOGARD HG".

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H-Shield-NB, H-Shield-NB NH

**JOHNS MANVILLE** — Nailboard.

**SOPREMA INC** — Sopra-ISO CV s.

3C. **Building Units\*** — As an alternate to Items 3 through 3B, polyisocyanurate foamed plastic insulation boards faced on the underside with wood fiber board. Min thickness of the polyisocyanurate core is 2.0 in. No limit on max overall thickness. Boards to be installed with end joints staggered a min of 6 in. in adjacent rows.

**FIRESTONE BUILDING PRODUCTS CO L L C** — "ISO 95+ Wood Fiberboard Composite".

**JOHNS MANVILLE** — ENRGY 2 Plus.

3D. **Building Units\*** — As an alternate to Items 3 through 3C, polyisocyanurate foamed plastic insulation boards faced on the underside (or both sides) with mineral fiber board. Min thickness of the polyisocyanurate core is 2.0 in. No limit on max overall thickness. Boards to be installed with end joints staggered a min of 6 in. in adjacent rows.

**FIRESTONE BUILDING PRODUCTS CO L L C** — "ISO 95+ Composite".

**JOHNS MANVILLE** — Fesco-Foam.

3E. **Building Units\*** — Not Shown — As an alternate to Items 3 and 3D, composite polyisocyanurate foamed plastic insulation board with an adhered nailing surface, nom 48 by 48 or 96 in. may be used with the following limitations. These composite building units have ventilation slots internal to the panels. The thickness of the panel depends upon the thinnest portion of the polyisocyanurate insulation. The following dimensions apply to the polyisocyanurate insulation, min 2 in. thick. May be installed over a max 1 in. thick layer of mineral and fiber boards (Item 3B) with joints offset a min of 6 in., in each direction. There is no limit on the max insulation thickness.

**JOHNS MANVILLE** — Type ISO-VENT.

3F. **Building units\*** — As an alternate to Items 3 through 3E, polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in., faced on the top surface with gypsum board. Min thickness of the polyisocyanurate core is 2.0 in. No limit on overall thickness. Boards to be installed with end joints staggered a min of 6 in. in adjacent rows.

**JOHNS MANVILLE** — ENRGY 2 Gypsum Composite.

3G. **Foamed Plastic\*** — Optional - (Not Shown) - Used in addition to the foam insulation required to achieve fire rating:

3Ga. **Foamed Plastic\*** — Optional - (Not Shown) - Maximum 1 in. thick polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in. Boards may be applied as the top layer in addition to the specified minimum thickness of any roofing system described herein, as long as the roofing system states that there is no limit on maximum thickness. Joints offset in both directions from layer below.

**FIRESTONE BUILDING PRODUCTS CO L L C** — "ISOGARD HD".

3Gb. **Foamed Plastic\*** — Optional — (Not Shown) — Maximum 5/8 inch thick polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in. Boards may be applied as the top layer in addition to the specified minimum thickness of any roofing system described herein, as long as the roofing system states that there is no limit on maximum thickness. Joints offset in both directions from layer below.

**RMAX, A BUSINESS UNIT OF SIKA CORPORATION** — "Ultra-Max HD"

**SIKA SARNAFIL INC** — Sarnatherm Roof Board-R

3Gc. **Foamed Plastic\*** — Optional — (Not Shown) — Maximum 1/2 inch thick polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in. Boards may be applied as the top layer in addition to the specified minimum thickness of any roofing system described herein, as long as the roofing system states that there is no limit on maximum thickness. Joints offset in both directions from layer below.

**CARLISLE SYNTEC SYSTEMS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — SecurShield HD, SecurShield HD Plus, SecurShield HD NH, SecurShield HD Plus NH, SecurShield HD RL

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H-Shield HD, H-Shield HD90, H-Shield HD RL, H-Shield HD NH, H-Shield HD90 NH

**VERSICO INC** — SecurShield HD Plus, WeatherBond XFP HD Plus Cover Board, SecurShield HD NH, WeatherBond XFP HD NH Cover Board, SecurShield HD Plus NH, WeatherBond XFP HD Plus NH Cover Board, SecurShield HD RL

3Gd. **Foamed Plastic\*** — Optional — (Not Shown) — Maximum 1 inch thick polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in. Boards may be applied as the top layer in addition to the specified minimum thickness of any roofing system described herein, as long as the roofing system states that there is no limit on maximum thickness. Joints offset in both directions from layer below.

**ATLAS ROOFING CORP** — AC Foam HD CoverBoard and AC Foam CoverBoard FR

3H. **Building Units\*** — (Not Shown) — As an alternate to Item 3. Polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in., faced on the top surface with wood fiber board. For the building units, min thickness (as measured at core) of the polyisocyanurate foamed plastic insulation is 2.0 in. (No limit on max thickness). Building units to be installed with end joints staggered a min 6 in. in adjacent rows.

**CARLISLE SYNTEC SYSTEMS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — Polyiso HP-H Composite NH

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H-Shield-WF, H-Shield-WF NH

**VERSICO INC** — MP-HWF NH, WeatherBond XP-WF NH

3I. **Building Units\*** — (Not Shown) — As an alternate to Item 3. Polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in., faced on the top surface with perlite composite board. For the building units, min thickness (as measured at core) of the polyisocyanurate foamed plastic insulation is 2.0 in. (No limit on max thickness). Building units to be installed with end joints staggered a min 6 in. in adjacent rows.

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H-Shield-P, H-Shield-RP, H-Shield-P NH, H-Shield-RP NH

3J. **Building Units\*** — (Not Shown) — As an alternate to Item 3. Polyisocyanurate foamed plastic insulation boards, nom 48 by 48 or 96 in., faced on the top surface with glass mat faced gypsum panel. For the building units, min thickness (as measured at core) of the polyisocyanurate foamed plastic insulation is 2.0 in. (No limit on max thickness). Building units to be installed with end joints staggered a min 6 in. in adjacent rows.

**CARLISLE SYNTEC SYSTEMS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — Polyiso HP-HDD, Polyiso HP-HDD NH

**HUNTER PANELS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — H-Shield-DD, H-Shield-DD NH

**VERSICO INC** — MP-HDD, MP-HDD NH

3K. **Foamed Plastic\*** — **As an alternate to Items 3 through 3F** — Polyurethane foamed plastic roof insulation. Formed by the simultaneous spraying of two liquid components applied over the gypsum wallboard (item 3L) in accordance with the manufacturer's instructions. Minimum nominal thickness is 2.0 in. with no maximum thickness.

**BASF CORP** — Types FE348-2.5, FE348-2.8, FE348-3.0, ELASTOSPRAY 81255, ELASTOSPRAY 81285, ELASTOSPRAY 81305, SKYTITE C1

**BASF CORP** — Elastospray 5100-2.0, Elastospray 5100-2.5, Elastospray 81302, Elastospray 81272, Elastospray Alpha System, Elastospray 81252.

3L. **Gypsum Board** — (Classified or unclassified) — For use with Item 3K. Supplied in sheets nom 2 by 4 ft to 4 by 12 ft, by nom 5/8 in. thick. Min weight 2.0 psf. Applied perpendicular to steel roof deck or direction with adhesive or laid loosely. End joints to occur over crests of steel roof deck with end joints staggered 2 ft in adjacent rows.

See **Gypsum Board** (CKNX) category for names of manufacturers.

4. **Vapor Retarder — Sheathing Material\*** — (Optional) — Vinyl film or paper scrim vapor barrier, applied to steel roof deck with adhesive (Item 5), asphalt (Item 5A) or laid loosely, overlapped approx 2 in. on adjacent sheets. See Sheathing Materials (CHIZ) category for names of manufacturers.

4A. **Sheathing Material\*** — (Optional) — In lieu of Item 4, a self adhered rubberized asphalt roofing underlayment membrane which may be placed on top of the steel roof deck (Item 7).

**GCP APPLIED TECHNOLOGIES INC** — Grace Ice and Water Shield, Grace Ice and Water Shield-HT®, Grace Select, Grace Ultra, and Grace Basik.

5. **Adhesive\*** — (Optional) — May be applied between crests of steel roof deck and vapor retarder, between vapor retarder and first layer of insulation, and between layers of insulation. Applied in 1/2 in. wide ribbons 6 in. OC at 0.4 gal/100 sq ft. See Adhesives (BYWR)

category for names of manufacturers.

5A. **Asphalt Or Coal Tar Pitch\*** — (Optional — Not Shown) — In lieu of Item 5, used to attach the first layer of insulation to vapor retarder and each additional layer of roof insulation. Applied at a max rate of 25 lbs/100 sq ft.

5B. **Adhesive\* -(Optional)** — (Bearing the UL Classification Marking for Roof Systems (TGFU)) - When FAST 100 adhesive is used, the Unrestrained Assembly Ratings are limited to 1, 1-1/2 and 2 hr. The vapor retarder, the gypsum wallboard or the first layer of roof insulation may be secured with adhesive to the steel crest surfaces. Also used to attach the vapor retarder to gypsum wallboard, the first layer of insulation to vapor retarder or gypsum wallboard and each additional layer of insulation. Applied at a max rate of 19.8 g/ft<sup>2</sup>. When FAST 100 adhesive is used, additional **Spray-Applied Fire Resistance Materials\* (CHPX)** is required on the deck for the 1-1/2 and 2 hr Unrestrained Assembly Ratings. The thickness specified for the deck shall be increased by 1/16 in. for 1-1/2 hr Unrestrained Assembly Rating and 1/4 in. for 2 hr Unrestrained Assembly Rating.

**CARLISLE SYNTEC SYSTEMS, A DIVISION OF CARLISLE CONSTRUCTION MATERIALS, LLC** — FAST 100.

6. **Mechanical Fasteners** — (Optional — Not Shown) — Mechanical screw-type fastener with metal washer designed for the purpose may be used to attach one or more layers of insulation to steel roof deck.

7. **Steel Roof Deck — (Unclassified)** — Min 1-1/2 in. deep and 30 or 36 in. wide galv fluted steel deck. Flutes 6 in. OC with crest width ranging from 3-5/8 to 5-1/16 in. Min gauge is 22 MSG. Ends overlapped at supports min 1-1/2 in. and welded to supports at deck laps and a max of 12 in. OC between sides of units. Side laps of adjacent units welded, button-punched or secured together with No. 12 by 3/4 in. long self-drilling, self-tapping steel screws spaced a max of 36 in. OC. **Classified Steel Floor and Form Units\*** — Noncomposite, 1-1/2 in. deep, galv units, min gauge is 22 MSG. Ends overlapped at supports min 1-1/2 in. and welded to supports at deck laps and a max of 12 in. OC between sides of units. Side laps of adjacent units welded, button-punched or secured together with No. 12 by 3/4 in. long self-drilling, self-tapping steel screws spaced a max of 36 in. OC.

**ASC STEEL DECK, DIV OF ASC PROFILES L L C** — Types BH-36, BHN-36, BHN-35-1/4, DGB-36, B-36, BN-36, BN-35-1/4, DGN-32, N-32, NN-32, 2WH-36, 2WS-36, 3WXH-36, 3WH-36. All units may be galvanized or Prime Shield™. Non-cellular decks may be vented designated with a "V" suffix to the product name.

**CANAM GROUP INC** — Type P-3606 or P-3615; 36 in. wide Types 1.5B, 1.5BI

**CANAM STEEL CORP** — Type P-3606 or P-3615.

**CANAM STEEL CORP** — Types B, NS. Units may be ptd/ptd.

**NEW MILLENNIUM BUILDING SYSTEMS L L C** — Type B, BD, BI, F, FD, N, ND, NW32 and NW32I. Units may be phos/painted or galvanized.

**STEEL MASTERS INTERNATIONAL DEPENDABLE STEEL** — 36 in. wide Types 2WH-36, 3WH-36. Units may be phos/painted or galvanized.

**VERCO DECKING INC - A NUCOR CO** — Deck types PLB, HSB, PLN3, HSN3, PLN, N; FORMLOK™ deck types PLB, B, PLN3, N3, PLN, N, PLW2, W2, PLW3, W3. Units may be galvanized or phos./ptd. Deck may be vented or non-vented.

**VULCRAFT, DIV OF NUCOR CORP** — Types 1.5F, 1.5B, 1.5BI, 1.5PLB, 3N, 3NI, 3.0 PLN, 3NL-32, 3NI-32, 3PLN-32; ptd/ptd units may be used for ratings up to 2 hr; Types BW, N. Type BW may be ptd/ptd.

8. **Spray-Applied Fire Resistive Materials\*** — Applied by mixing with water and spraying in more than one coat to the thickness shown below, to steel surfaces which are clean and free of dirt, loose scale, and oil. Min average and min individual density of 15 and 14 pcf, respectively, for Types 300, 300AC, 300ES, 300HS, 300N, 3000, 3000ES and SB. For Types 400AC and 400ES min average and min individual density of 22 and 19 pcf, respectively. Min avg density of 44 pcf with min ind value of 40 pcf for Types M-II and TG. Min avg density of 47 pcf, with min individual value of 43 pcf for Type M-II/P. For method of density determination, see Design Information Section, Sprayed Material. Spray-Applied Fire Resistive Materials on steel deck shall cover screw tips by 1/2 in. min. Use of adhesive (Item 11) is required.

The min thicknesses of Spray-Applied Fire Resistive Materials required for various fire resistance ratings are shown in the table below:

Restrained Assembly Rating Hr	Unrestrained Assembly Rating Hr	Unrestrained Beam Rating Hr	Protection Mtl Thkns In.		
			on Deck#	on Beam	on Joist
1	1	1	7/8	7/16	3/4
1	1	1	1-7/16+	7/16	3/4
1-1/2	1-1/2	1-1/2	1-3/16	9/16	1-3/16
1-1/2	1-1/2	1-1/2	2+	9/16	1-3/16
2	1	1	1-7/16	11/16	1-3/16
2	1-1/2	1-1/2	1-7/16	11/16	1-3/16
2	2	2	1-7/16	13/16	1-3/16
2	2	2	2-5/8+	13/16	1-3/16
3	1-1/2	1-1/2	1-7/16	1-3/16	1-5/8
					(1-1/2**)
3	2	2	1-7/8	1-3/16	1-5/8
					(1-1/2**)
3	3	3	1-7/8	1-1/4	1-5/8
					(1-1/2**)

# The required minimum thickness of Spray-Applied Fire Resistive Materials on the steel deck is increased by 1/16 in. for 1-1/2 hr Unrestrained Assembly Rating and 1/4 in. for 2 hr Unrestrained Assembly Rating when Item 5B is used.

+ No minimum insulation thickness required.

\*\* The 1-1/2 in. thickness may be applied when minimum size joist is 12K5.

**BERLIN CO LTD** — Types 300, 300ES, 300N, SB, M-II, TG and M-II/P.

**GREENTECH ASIA PACIFIC SDN BDH** — Types 300, 300ES, M-II, or M-II/P.

**GREENTECH THERMAL INSULATION PRODUCTS MFG CO L L C** — Types 300, 300AC, 400AC, M-II, TG and M-II/P.

**ISOLATEK INTERNATIONAL** — Types 300, 300AC, 300ES, 300HS, 300N, SB, 400AC, 400ES, 3000, 3000ES, M-II, TG and M-II/P.

**NEWKEM PRODUCTS CORP** — Types 300, 300ES, 300N, SB, M-II, TG and M-II/P.

**8A. (As an alternate to Item 8) Spray-Applied Fire Resistive Materials\*** — Applied by mixing with water and spraying in more than one coat to the thickness shown below, to steel surfaces which are clean and free of dirt, loose scale, and oil. Min average and min individual density of 17.5 and 16 pcf, respectively, for Types 300TW, . Min average and min individual density of 22 and 19 pcf, respectively, for Type 400. For method of density determination, see Design Information Section, Sprayed Material. Spray-Applied Fire Resistive Materials on steel deck shall cover screw tips by 1/2 in. min. Use of adhesive (Item 11) is required.

**GREENTECH ASIA PACIFIC SDN BDH** — Type 400.

**GREENTECH THERMAL INSULATION PRODUCTS MFG CO L L C** — Type 400.



**ISOLATEK INTERNATIONAL** — Type 300TW, Type 400.

**NEWKEM PRODUCTS CORP** — Type 400.

**8B. Sprayed Fiber Insulation\*** — (Optional, Not Shown) — Spray applied fiber insulation applied over Spray-Applied Fire Resistive Material (Item 8) on both steel floor and form units (Item 7) and supports (Item 1). Sprayed fiber insulation may be over Spray-Applied Fire Resistive Material (Item 8) according to the following tables:

**Allowable Spray-Applied Fiber Insulation Thickness Over Steel Deck**

Installed SFRM Thickness (in.) on Deck	SFRM Density (pcf)				
	15	17.5	22	44	47
1/2	8	8	8	8	8
3/4	8	8	8	8	8
13/16	8	8	8	8	8
15/16	8	8	8	8	8
1-1/16	7-3/4	8	8	8	8
1-1/8	7-1/2	8	8	8	8
1-1/2	5-7/8	6-7/8	8	8	8
1-11/16	5-1/16	5-15/16	7-7/16	8	8

**Allowable Spray-Applied Fiber Insulation Thickness Over Beam**

Installed SFRM Thickness (in.) on Beam	SFRM Density (pcf)				
	15	17.5	22	44	47
7/16	3-3/4	4-3/8	5-1/2	8	8
9/16	3-3/16	3-3/4	4-11/16	8	8
13/16	2-1/8	2-1/2	3-1/8	8	8
1-1/4	1/4	5/16	3/8	3-1/8	3-3/8

**Allowable Spray-Applied Fiber Insulation Thickness Over Joist**

Installed SFRM Thickness (in.) on Joist	SFRM Density (pcf)				
	15	17.5	22	44	47
3/4	8	8	8	8	8
15/16	8	8	8	8	8
1	8	8	8	8	8
1-3/16	7-1/4	8	8	8	8

1-5/8	5-3/8	6-1/4	7-7/8	8	8
-------	-------	-------	-------	---	---

**INTERNATIONAL CELLULOSE CORP** — Type K13, URE-K, or Sonospray FC

8D. **Sprayed Fiber Insulation\*** — (Optional, Not Shown) — Spray applied fiber insulation Classified for Noncombustible Building Materials (BICW), having a maximum applied density of 3.5 pcf, applied over Spray-Applied Fire Resistive Material (Item 8) on both steel floor and form units (Item 7) and supports (Item 1). Sprayed fiber insulation may be over Spray-Applied Fire Resistive Material (Item 8) according to the following tables:

### Allowable Spray-Applied Fiber Insulation Thickness Over Steel Deck

Installed SFRM Thickness (in.) on Deck	SFRM Density (pcf)				
	15	17.5	22	44	47
7/8	5	5	5	5	5
1 3/16	5	5	5	5	5
1 1/4	5	5	5	5	5
1 7/16	5	5	5	5	5
1 1/2	5	5	5	5	5
1 11/16	5	5	5	5	5
1 7/8	4 5/16	5	5	5	5
2	3 3/4	4 3/8	5	5	5
2 1/16	3 1/2	4 1/16	5	5	5
2 1/8	3 3/16	3 3/4	4 11/16	5	5
2 5/8	1 1/16	1 1/4	1 9/16	5	5
2 7/8	0	0	0	5	5

### Allowable Spray-Applied Fiber Insulation Thickness Over Beam

Installed SFRM Thickness (in.) on Beam	SFRM Density (pcf)				
	15	17.5	22	44	47
7/16	5	4 1/16	5	5	5
9/16	5	3 7/16	5	5	5
11/16	5	2 13/16	5	5	5
13/16	4 9/16	2 3/16	5	5	5
1 3/16	2 15/16	5/16	4 5/16	5	5

### Allowable Spray-Applied Fiber Insulation Thickness Over Joist

Installed SFRM Thickness (in.) on Joist	SFRM Density (pcf)
---	--------------------

	15	17.5	22	44	47
3/4	5	5	5	5	5
1 3/16	4 9/16	5	5	5	5
1 1/2	3 3/16	3 3/4	4 11/16	5	5
1 5/8	2 11/16	3 1/8	3 15/16	5	5

**THERMACOUSTICS IND** — Type TC-417

9. **Glass Fiber Mesh** — (Optional) — May be used to facilitate the spray application of the protection material to the steel bar joists. Min 3/32 in. sq mesh, coated fiberglass scrim fabric, weighing a min of 1.9 oz/sq yd shall be attached to one side of each joist web member. The method of attachment must be sufficient to hold the mesh and fire protection material during application and curing of the material. An acceptable method of attaching the mesh is by embedding the mesh in min 1/4 in. long beads of hot-melted glue. The beads of glue shall be spaced min 12 in. OC along the top chord of the bar joists. Another method of attachment is the use of 1-1/4 in. long 1/2 in. wide hairpin clips formed from 0.064 in. diam steel wire, alternating from top to bottom of the joist web member.

9A. **Metal Lath** — (Optional — Not Shown) — In lieu of Item 9, diamond mesh, 3/8 in. expanded steel, min 2.5 lb/sq yd fastened to one side of joists using No. 18 SWG steel tie wire, located at the midheight of every other web member or 18 in. OC whichever is less. Both sides of lath must be completely coated with Spray-Applied Fire Resistive Materials but with no minimum thickness requirements.

9B. **Metal Lath** — (For use on steel roof deck with Types M-II, TG, and M-II/P Spray Applied Fire Resistive Material) - 3/8 in. diamond mesh, min 2.5 lbs per sq yd painted or galv expanded steel. Fastened to steel roof deck with ribs (if any) facing down using. No. 8 by 1/2 in. wafer head self-drilling, self-tapping, coated steel screws spaced max 15 in OC in both directions for 1 and 1-1/2 hr ratings. Spaced a max 12 in. OC in both directions for 2 hr ratings. Lath edges overlapped approx 3 in.

10. **Bridging** — (Not Shown) — Min 1-1/4 by 1-1/4 by 1/8 in. thick steel angles welded to top and bottom chords of each joist. Number and spacing of bridging angles per Steel Joist Institute specification. Bridging coated with the same thickness of Spray-Applied Fire Resistive Materials as the joist to a min distance of 12 in. beyond each side of the joist.

11. **Adhesive\*** — Applied to steel roof deck in accordance with manufacturer's instructions.

**ISOLATEK INTERNATIONAL** — Type EBS or Type X.

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2021-05-18

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"