

BXUV.S801 - FIRE-RESISTANCE RATINGS - ANSI/UL 263

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances

See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances

Design No. S801


May 08, 2018

Restrained Beam Ratings — 1, 1-1/2, 2 or 3 Hr. (See Item 6)

Unrestrained Beam Ratings — 1, 1-1/2, 2 or 3 Hr. (See Item 6)

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide BXUV or BXUV7

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

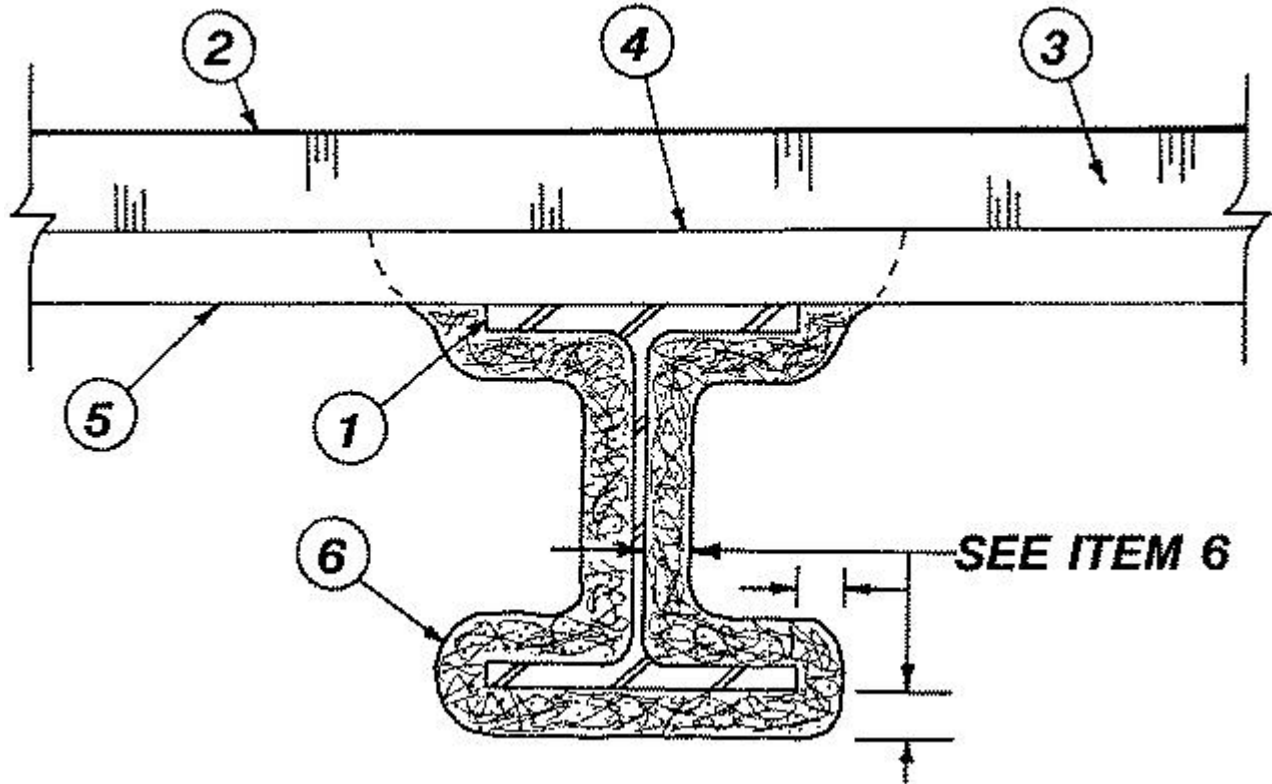

1. **Steel Beam** — W8X28 min size.

2. **Roof Covering*** — Consisting of hot mopped, cold application or single-ply materials, compatible with insulation(s) described herein which provide Class A, B or C coverings. See Roofing Materials and Systems Directory-Roof Covering Materials (TEVT).

3. **Roof Insulation*** — Mineral and fiber boards, applied in one or more layers. When multiple layers are used, end and side joints shall be offset a min of 12 in. in both directions in order to lap all joints. See Mineral and Fiber Boards (CERZ) Category in the Fire Resistance Directory for names of manufacturers. Roof insulation shall be compatible with Roof Covering (Item 2). See Roofing Materials and Systems Directory-Roof Covering Materials (TEVT).

4. **Adhesive*** — Applied to crests of roof deck units and/or insulation in 1/2 in. wide ribbons at 0.4 gal per 100 sq ft. See **Adhesives** (BYWR) category for names of companies which can supply adhesive.

5. **Steel Roof Deck** — (Unclassified) — Fluted, No. 22 MSG, galv, 1-1/2 in. deep with 3-1/2 in. wide flutes spaced 6 in. OC. Ends overlapped 1-1/2 min, at supports and welded 12 in. OC to supports. Adjacent units welded or button punched together 18 in. OC max.

6. **Spray-Applied Fire Resistive Materials*** — Applied by spraying with water in one or more coats to the final thicknesses shown below. Beam surfaces shall be clean and free of dirt, oil and loose scale. Areas between the underside of the roof units and the beam shall be filled with material. The use of adhesive prior to application of the material is optional. Tamping is optional.

**Restrained & Unrestrained
Beam Rating Hr**

Min Thkns In.

Restrained & Unrestrained Beam Rating Hr	Min Thkns In.
1	5/8
1-1/2	15/16
2	1-5/8
3	2-9/16

ISOLATEK INTERNATIONAL — Type D-C/F, II, or Type II HS, with min avg density of 13 pcf and min ind density of 11 pcf. Type HP, min avg and min ind densities of 22 and 19 pcf, respectively. Type D-C/F, HP, II, or Type II HS investigated for exterior use, Type EBS or Type X adhesive/sealer is optional. For method of density determination, refer to Design Information Section, Sprayed Material.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2018-05-08

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC"