

BXUV.N634 - Fire-resistance Ratings - ANSI/UL 263

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

Fire-resistance Ratings - ANSI/UL 263

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

[See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances](#)

[See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances](#)

Design No. N634


September 2, 2021

Restrained Beam Ratings - 1, 1-1/2, and 2 Hr. (See Item 7)

Unrestrained Beam Ratings - 1, 1-1/2 and 2 Hr. (See Item 7)

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide [BXUV](#) or [BXUV7](#)

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

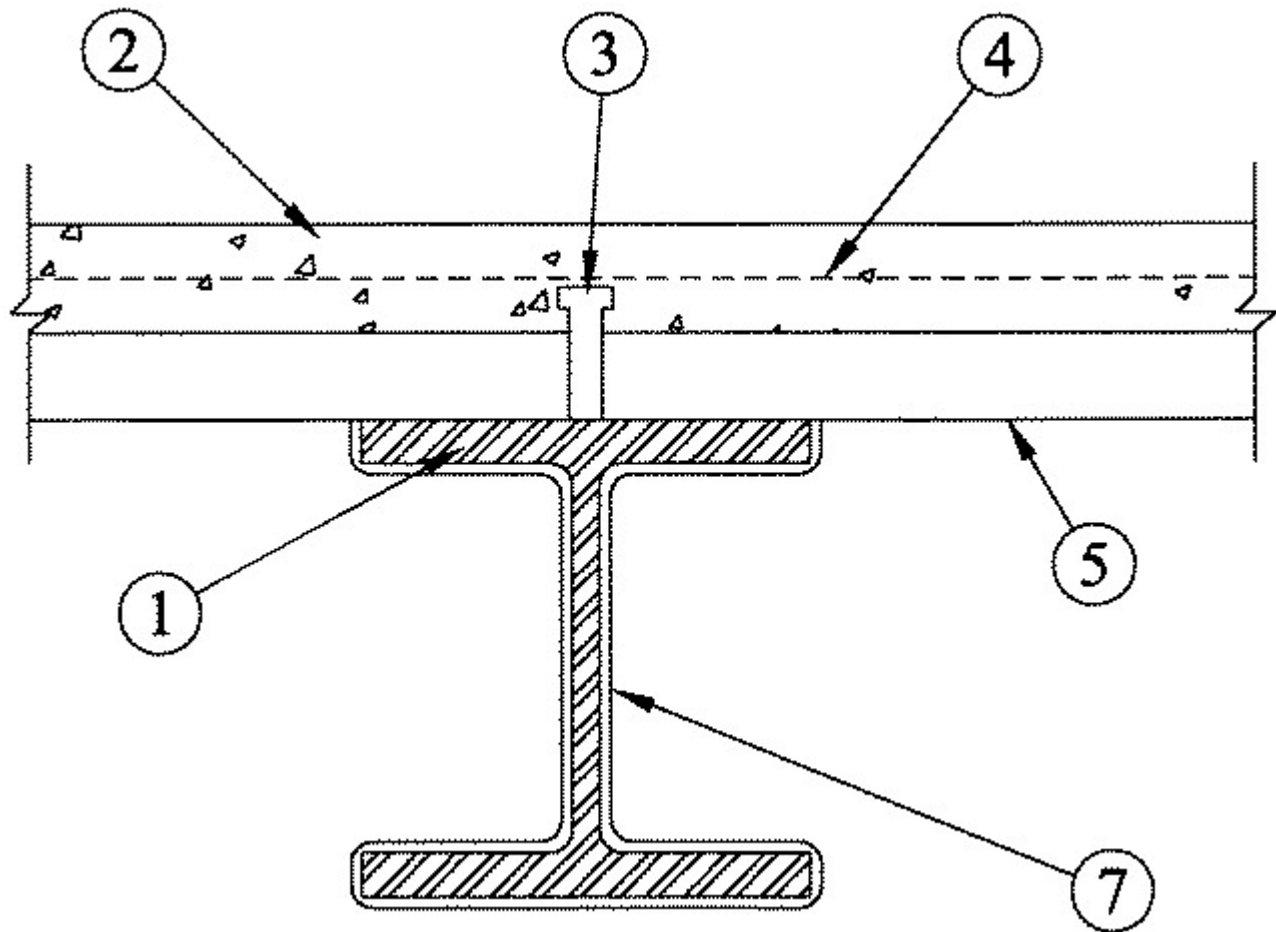

1. **Steel Beam** — Minimum beam sizes as shown in table below. Beams shall be free of dirt, loose scale and oil. Beams shall be primed with a metal alkyd primer at a nominal thickness of 2 mil or an epoxy primer at a nominal thickness of 1 mil.

2. **Normal Weight or Lightweight Concrete** — Compressive strength 3000 psi. For normal weight concrete either carbonate or siliceous aggregate may be used. Unit weight 145 lbs/cu ft. for normal weight concrete and 110 lbs/cu ft. for lightweight concrete. Min concrete thickness, as measured from top plane of steel floor and form units is 2-1/2 in.

3. **Shear Connector** — (Optional) — Studs, 3/4 in. diam headed type or equivalent per AISC specifications welded to the top flange of beam through the steel floor units.

4. **Welded Wire Fabric** — 6x6-10/10 SWG.

5. **Steel Floor or Form Units** — 1-1/2, 2 or 3 in. deep fluted units, welded to beam.

6. **Mineral Wool Insulation** — (Not Shown) — Min 4 pcf mineral wool insulation cut into pieces and firmly packed into, and completely filling the spaces between the flutes of the steel floor and form units and the top flange of the beam. Mineral wool is not required when the top flange of the beam is protected with intumescent coating at the same thickness shown in the table in Item 7.

7. **Intumescent Fire-resistive Materials*** — Coating spray or brush applied in accordance with the manufacturer's instructions at the min dry thickness as shown in the table below. The thickness shown below includes the primer thickness. When mineral wool (Item 6) is used, the top surface of the beam need not be protected with coating.

Beam Size	Beam W/D	Unrestrained Beam Rating, Hr.	Minimum Dry Thickness (NW Concrete)		Minimum Dry Thickness (LW Concrete)	
			mils	mm	mils	mm

W8x24	0.70	1	35	0.88	35	0.88
W8x24	0.70	1-1/2	59	1.48	60	1.52
W8x24	0.70	2	98	2.47	100	2.53
W8x28	0.81	1	22	0.56	24	0.60

Beam Size	Beam W/D	Restrained Beam Rating, Hr.	Minimum Dry Thickness (NW Concrete)		Minimum Dry Thickness (LW Concrete)	
			mils	mm	mils	mm
W8x24	0.70	1	35	0.88	35	0.88
W8x24	0.70	1-1/2	35	0.88	35	0.88
W8x24	0.70	2	69	1.74	70	1.78

GREENTECH ASIA PACIFIC SDN BDH — Type WB 5, Investigated for Interior Conditioned Space and Interior General Purpose, Investigated for Exterior Use with top coat as described in Item 8

GREENTECH THERMAL INSULATION PRODUCTS MFG CO L L C — Type WB 5, Investigated for Interior Conditioned Space and Interior General Purpose, Investigated for Exterior Use with top coat as described in Item 8

ISOLATEK INTERNATIONAL — Type SprayFilm-WB 5 and Type WB 5, Investigated for Interior Conditioned Space and Interior General Purpose, Investigated for Exterior Use with top coat as described in Item 8

NEWKEM PRODUCTS CORP — Type WB 5, Investigated for Interior Conditioned Space and Interior General Purpose, Investigated for Exterior Use with top coat as described in Item 8.

8. **Top Coat** — (Not Shown) — Type TNEMEC 740 required for Exterior Use with Type SprayFilm WB5, applied at a minimum dry thickness of 7 mils over the intumescent material. See Classification information in the Mastic and Intumescent Coating (CDWZ) category, Isolatek International, for mixing requirements.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2021-09-02

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission

from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2022 UL LLC"