

PRODUCT DESCRIPTION

CAFCO FENDOLITE M-II / ISOLATEK Type M-II is a single package, factory controlled Spray-Applied Fire Resistive Material (SFRM) recommended for use in petrochemical facilities, refineries, nuclear/power plants, and tunnels.

CAFCO FENDOLITE M-II / ISOLATEK Type M-II can be a spray texture or smooth trowel finished and requires only the addition of water as an activator. Tested and developed for fire protection of external structural steel components such as tanks, support legs and saddles, piperacks, vessel skirts, sphere legs or interior situations where higher levels of abrasion resistance are necessary.

CAFCO FENDOLITE TG / ISOLATEK Type TG is specifically developed only for trowel application in areas where spraying is impractical or not permitted.

PRODUCT ADVANTAGES

- Proven material with over 30 years of in-place performance in hydrocarbon environments
- Tested to the latest industry fire standards (hydrocarbon and jet fire) including exposure to gas explosion and liquid nitrogen
- Vermiculite aggregate provides excellent thermal resistance
- Formulated for durability offering long-term weather, abrasion, and erosion resistance, including high level impact protection
- Reduced thicknesses deliver required ratings with less material
- Lightweight relative to concrete, lowering construction costs with savings in transportation and installation

Physical Performance

Characteristic	ASTM Method	Laboratory Tested Performance*
Density	E605	44-48 pcf (704-768 kg/m ³)
Durometer Hardness (Shore DO)	D2240	65+
Surface Burning	E84	Flame Spread 0 Smoke Developed 0
Combustibility	E136	Noncombustible
Cohesion/Adhesion	E736	17,258 psf (826.3 kPa)
Deflection	E759	No Cracks or Delaminations
Bond Impact	E760	No Cracks or Delaminations
Compressive Strength	E761	561.7 psi (3,872.6 kPa)
Air Erosion Resistance	E859	0.000 g/ft ² (0.000 g/m ²)
Corrosion Resistance	E937	Does Not Promote Corrosion of Steel
Thermal Conductivity	C518	1.248 BTU in/hr ft ² °F @75°F (0.14 W/m·K) (R Value = 0.86 / in)
Fungal Resistance	G21	Passed

* Values represent independent laboratory tests under controlled conditions. Test reports available upon request.

FIRE TEST PERFORMANCE

CAFCO FENDOLITE M-II / ISOLATEK Type M-II has been extensively tested for fire endurance in accordance with industry specific protocols.

- ANSI/UL1709 Rapid Rise Fire Test of Protection Materials for Structural Steel – UL Designs XR704, XR729, XR730
- ANSI/UL1709 Rapid Rise Fire Test as above however subjecting CAFCO FENDOLITE M II / ISOLATEK Type M-II to Two Full Scale UL 1709 Fire Tests within a 24-hour period (tested, allowed to cool to ambient and re-tested)
- ANSI/UL1709 Rapid Rise Fire Test (following Gas Explosion Test)
- ANSI/UL1709 Rapid Rise Fire Test (following Liquid Nitrogen Immersion Test)
- BS476, Parts 20-21: 1987 Appendix D-Hydrocarbon Heating Conditions
- Gas Explosion Test (3 Bar Overpressure)
- ISO 22899-1:2007(E) Determination of the Resistance to Jet Fires of Passive Fire Protection Materials
- ISO 22899-1:2007(E) Determination of the Resistance to Jet Fires (following Gas Explosion Test)
- NFPA 58, Annex H Procedure for Torch Fire and Hose Stream Testing of Thermal Insulating Systems for LP-Gas Containers
- Factory Mutual (FM) Fire Protective Coating for LP-Gas Steel Storage Vessels and Process Structures (Class 4971)
- GEIS GASAFE Program – LPG Storage Vessels
- Rijkswaterstaat (RWS) Curve
- Increased Time/Temperature Curve – HCinc
- ISO 20088-1(2016) - Standard for Determination of the Resistance to Cryogenic Spillage of Insulation Materials
- ISO 20088-1:2016 Cryogenic Resistance Followed by ISO 22899-1:2007 Resistance to Jet Fires

ENVIRONMENTAL TEST PERFORMANCE

In addition to the required ANSI/UL1709 environmental test conditions (Aging, High Humidity, Industrial Atmosphere, Salt Spray and Combined Wet/Freeze/Dry Cycling), CAFCO FENDOLITE M-II / ISOLATEK Type M-II has also been tested under the following conditions:

- Acid Spray - Exposure of the material (with and without topcoat) to a hydrochloric acid /water fog spray.
- Solvent Spray - Exposure of the material (with and without topcoat) to a spray applied solvent for 5 cycles. Each cycle consists of the application of the solvent, 6 hour dry time, re-application of the solvent, and dry time of 18 hours.
- Investigated for UL 2431 Classification Category I-A - Outdoor, Heavy Industrial Use

SPECIFICATION AND STANDARDS COMPLIANCE

American Petroleum Institute (API) Section 2510, 2510A, 2218

Technical Data


Color	Off-White
Theoretical Coverage (gross)	16 Bd. Ft./Bag
Thickness	Depends on desired rating and assembly being protected
VOC Compliance	0.0 g/L (EPA Method 24)
Outgassing Analysis, ATD GC-MS (50° C @ 30 mins.)	<12 ppmw (ug/g)
Storage	Dry, Covered, Off-Ground
Shelf Life	24 months



Brand

**Design No. XR729
BYBU.XR729**

Fire-resistance Ratings - ANSI/UL 1709

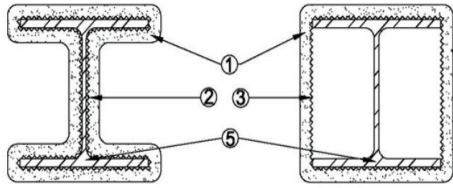


- Spray-Applied Fire-Resistive Materials*** — See table below for appropriate thickness. Prepared by mixing with water according to instructions on each bag of mixture and spraying in one or more coats, as necessary, directly to the column or onto the metal lath surfaces, which must be clean and free of dirt, loose scale and oil. Min avg density of 44 pcf, with min individual value of 40 pcf for FENDOLITE® M-II / Type M-II. Min avg density of 44 pcf, with min individual value of 42 pcf for FENDOLITE TG / Type TG. For method of density determination, see Design Information Section, Sprayed Material.
- Metal Lath** — Galv. expanded steel lath, weighing 3.4 lb per sq yd may be used. Metal lath wrapped around the column profile and secured tight to column by gunned or stud welding pins. Lath lapped 1-1/2 to 3 in. and attached with fasteners at max 24 in. on center at overlaps.
- Metal Lath** — For boxed type protection. Min 3.4 lb per sq yd expanded steel. Lath lapped 1-1/2 to 3 in. at vertical joint on column flange and tied together with No. 18 SWG galv steel wire, spaced vertically 14 in. OC.
- Corner Bead** — (Optional-Not Shown) — No. 25 MSG galv expanded steel corner bead with minimum 2-in. legs. May be used in conjunction with column cage. When used, placed over each corner of column cage and attached to metal lath with tie wire spaced 18 in. OC.
- Steel Column** — Min size of column W10x49.

UL Design XR729

Rating, Hr.	Min Thickness, (In.) mm	Min Thickness, (In.) mm
	Contour Application	Boxed Protection
3/4	11/16 (17.5)	11/16 (17.5)
1	13/16 (20.7)	13/16 (20.7)
1-1/2	1-1/16 (27.0)	15/16 (23.9)
2	1-1/4 (31.8)	15/16 (23.9)
2-1/2	1-7/16 (36.6)	1-3/16 (30.2)
3	1-9/16 (39.7)	1-7/16 (36.6)
4	1-7/8 (47.6)	1-7/8 (47.6)

**Design No. XR730
BYBU.XR730**

Fire-resistance Ratings - ANSI/UL 1709

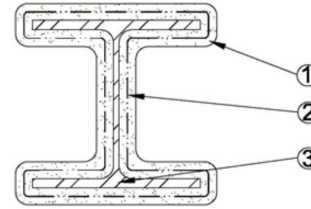

- Spray-Applied Fire-Resistive Materials*** — See table below for appropriate thickness. Prepared by mixing with water according to instructions on each bag of mixture and spraying in one or more coats, as necessary, to the column surfaces, which must be clean and free of dirt, loose scale and oil. Application to follow the column profile. Min avg. density of 704 kg/m³ (44 pcf), with min ind. value of 640 kg/m³ (40 pcf) for Type M-II. Min avg density of 753 kg/m³ (47 pcf), with min ind. value of 689 kg/m³ (43 pcf) for Type M-II/P. Min avg. density of 704 kg/m³ (44 pcf), with min ind. value of 672 kg/m³ (42 pcf) for Type TG. For method of density determination, see Design Information Section, Sprayed Material.
- Reinforced Mesh** — No. 20 SWG galv steel wire twisted to form 1 or 2 in. hexagons. Mesh attached with steel helical pins or straight pins with washers 16 in. on center to the center of the column flanges and webs prior to application of Spray-Applied Fire Resistive Material. Mesh wrapped around the column and embedded at approximate mid-depth in Spray-Applied Fire Resistive Materials with a min. 3 inch overlap at vertical and horizontal joints. When Type TG is used, mesh shall not be installed until approximate mid-depth has been applied.
- Steel Column** — Min size of column W10x49.

UL Design XR730

Rating, Hr.	Min Thickness, mm
3/4	17.5
1	20.7
1-1/2	27.0
2	32.5
2-1/2	36.8
3	41.2
4	50.0



ISOLATEK INTERNATIONAL is registered with the AIA Continuing Education System (AIA/CES)



We support our customers with unsurpassed technical expertise and customer service, complemented by an extensive global network of experienced sales representatives and recognized applicators. For detailed product information or for the name of the sales representative in your area please contact us.

The performance data herein reflect our expectations based on tests conducted in accordance with recognized standard methods under controlled conditions. The applicator, general contractor, property owner and/or user MUST read, understand and follow the directions, specifications and/or recommendations set forth in Isolatek International's publications concerning use and application of these products, and should not rely merely on the information contained in this Technical Data Sheet. Isolatek International is not responsible for property damage, bodily injuries, consequential damages, or losses of any kind that arise from or are related to the applicator's general contractor's, or property owner's failure to follow the recommendations set forth in Isolatek International's publications. The sale of these products shall be subject to the Terms and Conditions set forth in the Company's invoices.



Isolatek International provides passive fireproofing materials under the CAFCO® and FENDOLITE® trademarks throughout the Americas and under the ISOLATEK® trademark throughout the world.

800.631.9600 or 973.347.1200
www.isolatek.com | technical@isolatek.com
technical-international@isolatek.com

